

UPF Hot Work Permit



Preparer: Kellie R. Coleman 11/09/23  
 Kellie R. Coleman  
 UPF Issues Management Date

Approval: Brent M. Albertsen 11/09/23  
 Brent M. Albertsen  
 UPF Engineering Group Supervisor  
 (HVAC/FP/MET/EQ/SPEC MECH) Date

Bradley A. Lewis 11/09/23  
 Bradley A. Lewis  
 UPF Project Field Engineer Date

Donald E. Sproul 11/09/23  
 Donald E. Sproul  
 UPF ES&H Construction, CNS Date

Kieran S. Kelly 11/13/23  
 Kieran S. Kelly  
 UPF ES&H Manager, BNI Date

Gary J. Cough 11/13/23  
 Gary J. Cough  
 UPF Site Manager Date

11/13/23  
 Effective Date

UPF Hot Work Permit

## REVISION LOG

### Revision 4

 Intent  Non-Intent

 Implements PRMS Requirements:  Yes  No

- No forms have been edited as part of this revision
- Updated Section 1.2, *Scope*
- Added Appendix F, *Approved Powder Actuated Fastener Tools*
- Other changes include:
  - Updated Section 3.1.3
  - Added Section 5.3, *Forms*
  - Updated references
  - Updated acronyms and definitions
  - Editorial changes

### Revision 3

 Intent  Non-Intent

- This change is in response to Condition Report 25774-000-GCA-GAM-03415, *Personnel Conducting Relief Fire Watch Not Signing-Off On Hot Work Permits (MAW-SH-801768-FY21-001)*
  - Added the following to NOTE under Section 3.2.10, sub-header "Fire Watch": All Fire Watches assigned to the hot work, including relief Fire Watches, must review and sign CFN-1139.
- No forms have been edited as part of this revision
- An evaluation determination has been performed confirming that this Procedure implements requirements tracked in the Programmatic Requirements Management System (PRMS)
- Other changes include:
  - Added a paragraph to and deleted a note from Section 3.1.3
  - Added new Sections 3.1.4 and 3.1.5
  - Updated Note in Section 3.2.10
  - Updated Section 4.0, *Records*
  - Updated acronyms
  - Editorial changes

### Previous revisions on record

## CONTENTS

<b>1.0 INTRODUCTION.....</b>	<b>4</b>
1.1 Purpose.....	4
1.2 Scope.....	4
<b>2.0 RESPONSIBILITIES.....</b>	<b>4</b>
2.1 UPF Site Manager.....	4
2.2 UPF Project Superintendent.....	5
2.3 UPF Responsible Superintendent.....	5
2.4 Permit Authorizing Individual.....	5
2.5 BNI Fire Protection Engineer or Delegate.....	5
2.6 Hot Work Operator.....	5
2.7 Fire Watch.....	6
<b>3.0 PROCEDURE.....</b>	<b>6</b>
3.1 Establishing Permissible Areas.....	6
3.2 Performing Hot Work.....	10
<b>4.0 RECORDS.....</b>	<b>11</b>
<b>5.0 REFERENCES.....</b>	<b>12</b>
5.1 Source References.....	12
5.2 Interfacing References.....	12
5.3 Forms.....	12
<b>6.0 SUPPLEMENTAL INFORMATION.....</b>	<b>12</b>
<b>APPENDIX A Acronyms and Definitions.....</b>	<b>14</b>
<b>APPENDIX B Equipment/Materials within a Permissible Area.....</b>	<b>16</b>
<b>APPENDIX C Hot Work Permit Decision Tree.....</b>	<b>17</b>
<b>APPENDIX D Fire Watch Decision Tree.....</b>	<b>18</b>
<b>APPENDIX E Hot Work 35-Foot Rule.....</b>	<b>19</b>
<b>APPENDIX F Approved Powder Actuated Fastener Tools.....</b>	<b>20</b>

## 1.0 INTRODUCTION

### 1.1 Purpose

This Procedure establishes and implements controls to prevent fires as a result of hot work at the Uranium Processing Facility (UPF) and establishes areas authorized by management where hot work is permitted.

### 1.2 Scope

This Procedure applies to UPF activities that involve the following hot work processes:

- Welding (excludes autogenous orbital tube welding)
- Cutting with open flame, torches, or other means that generate sparks
- Use of open flame (including torch-applied roofing)
- Grinding (with disks, wheels, or other power-operated tools)
- Use of CAD/Thermit welds (such as for bonding of electrical grounding conductors to metal substrates)
- Other spark- or molten metal-producing activities defined as hot work performed in either Designated Areas or Permit-Required Areas

This Procedure shall not apply to the following processes:

- Use of cutting tools that result in an unintended spark(s)
- Electric soldering irons

Hot work on systems that contain or have contained flammable or combustible liquids or flammable gases is prohibited. Exception: Hot work on lines containing HVAC refrigerant shall be allowed with prior evaluation and approval by Bechtel National, Inc. (BNI) Environmental, Safety, and Health (ES&H).

Powder Actuated Fastener operations shall be evaluated to verify that the operation: (1) is incapable of generating mobile sources of ignition; (2) does not generate sustained heat sufficient to support combustion of combustible materials; and (3) only poses a hazard in flammable atmospheres (painting/coatings work). For a list of powder actuated tools that have been evaluated and determined to not require a hot work permit, refer to **Appendix F, Approved Powder Actuated Fastener Tools**. Should another model of powder actuated tool need to be used, it will require a hot work permit until an evaluation is performed, and the evaluation determines and documents that the tool does not require a hot work permit.

Applicability to subcontractor employees is as specified in subcontract language.

## 2.0 RESPONSIBILITIES

### 2.1 UPF Site Manager

The Site Manager is responsible for ensuring the requirements of this Procedure are properly implemented.

## 2.2 UPF Project Superintendent

The Project Superintendent is responsible for the following:

- Overall safe hot work operations
- Ensuring all individuals involved in the hot work operations, including subcontractors, are familiar with and implement the provisions of this Procedure
- Designating Permit Authorizing Individuals (PAIs)

## 2.3 UPF Responsible Superintendent

The Responsible Superintendent (or designee) is responsible for the following:

- Ensuring individuals involved in hot work operations are trained in the safe operation of their equipment and in the safe use of the process
- Ensuring workers involved in hot work operations are:
  - Trained to the requirements of this Procedure
  - Aware of the inherent risks involved and understand the emergency procedures in the event of fire

## 2.4 Permit Authorizing Individual

The PAI is responsible for the following:

- Considering the safety of the hot work operator and Fire Watch with respect to personal protective equipment (PPE) for other special hazards beyond hot work
- Determining site-specific flammable materials, hazardous processes, or other potential fire hazards that are present or likely to be present in the work location
- Ensuring the protection of combustibles from ignition
- Determining when and where hot work can be performed
- Ensuring that fire protection and extinguishing equipment are properly located at the work area
- Establishing Permissible Areas for hot work operations
- Assigning a qualified Fire Watch for hot work operation in Permit-Required Areas
- In Designated Areas where a Fire Watch is not required, ensuring final check of the hot work location approximately 30 minutes after the completion of hot work operations to detect and extinguish smoldering fires

## 2.5 BNI Fire Protection Engineer or Delegate

The BNI, Fire Protection Engineer (FPE) or Delegate is responsible for the following:

- Approving exceptions or enhancements to the requirements annotated in this document
- Reviewing CFN-1137, *UPF Designated Area Tracking and Inspection Log*, monthly

## 2.6 Hot Work Operator

Hot Work Operator(s) are responsible for the following:

UPF Hot Work Permit
---------------------

- Knowing and understanding the environment in which the work is to be performed, and complying with the permit generated by this Procedure
- Knowing the most current safe operation practices for their equipment
- Receiving PAI approval before starting hot work operations
- Ceasing hot work operations if unsafe conditions develop
- Notifying the PAI for reassessment of the situation if unsafe conditions develop

## 2.7 Fire Watch

A Fire Watch shall perform duties in accordance with UPF-CP-227, *UPF Safety Watches*, with emphasis on the following:

- Stopping the hot work operations if unsafe conditions develop
- Having fire-extinguishing equipment readily available and be trained in its use
- In the event of a fire:
  - Potentially attempting to extinguish the fire
  - Notifying and clearing out nearby personnel
  - Notifying supervisor and PAI, and ensuring the Y-12 National Security Complex Operations Center has been contacted

## 3.0 PROCEDURE

**NOTE 1:** *Welding blanket, welding curtains, and welding pads are approved. Fire resistant plastic sheeting is not approved for hot work operations.*

**NOTE 2:** *Exceptions to the following requirements may be made based on approval from the BNI FPE and documented on the Hot Work Permit.*

### 3.1 Establishing Permissible Areas

#### Permit Requestor

3.1.1 Ensure a Job Hazard Analysis related to a work package is completed, as applicable, in accordance with Y17-95-64-823, *UPF Field Level Hazard Assessment/Job Hazard Analysis (FLHA/JHA) Process*.

**NOTE:** *Appendix C, Hot Work Permit Decision Tree, is provided to determine if a hot work permit is necessary.*

3.1.2 Ensure CFN-1139, *UPF Hot Work Permit*, or Section 1, "Establishment of a Designated Area," of CFN-1137 has been initiated for hot work area inspection.

#### Permit Authorizing Individual

3.1.3 Ensure an alternative method to hot work has been considered to protect combustibles from ignition. IF the scope of work and the tools used to conduct hot work could result in possible travel of mobile sources of ignition (e.g., slag, sparks, spatter) farther than 35 feet, the PAI is permitted to increase the 35-foot boundary with approval from the BNI FPE and documented on CFN-1139. THEN ensure the distances and areas addressed in **Sections 3.1.7 through 3.1.14** are extended. IF the

**UPF Hot Work Permit**

scope of work and the tools used to conduct hot work are known to be incapable of generating mobile sources of ignition capable of leaving the immediate area of the applied hot work (e.g., Tungsten Inert Gas [TIG] welding, Metal Inert Gas [MIG] welding, and, in some cases, powder actuated fasteners), the PAI is permitted to reduce the 35-foot boundary with approval from the BNI FPE and documented on CFN-1139. THEN ensure the distance and areas addressed in **Sections 3.1.7** through **3.1.14** are reduced.

**NOTE 1:** *Steps 3.1.4 through 3.1.23 may be performed in any order.*

**NOTE 2:** *Hot work operations that might fall into the category where the 35-Foot Rule could be enlarged include, but are not limited to, elevated hot work areas and windy conditions.*

3.1.4 Ensure the hot work equipment to be used is in satisfactory operating condition.

3.1.5 IF floors (including temporary flooring material) are combustible, THEN perform any the following:

- Keep floors wet
- Protect with welding blanket or welding pad

**WARNING**

**The possibility of electrocution or serious physical harm exists where an employee is working with or near electrical equipment that is in contact with moisture.**

IF floors have been wetted down AND personnel are operating arc welding equipment or cutting equipment, THEN ensure personnel will be protected from possible shock.

3.1.6 IF combustible materials (e.g., clippings, wood shavings, or textile fibers) are on the floor within the hot work area, THEN remove the material from the floor.

**NOTE:** *When hot work is performed at an elevated level, it should be noted that sparks or slag can fall at a trajectory and land farther than 35 feet horizontally from a point directly under the hot work operator.*

3.1.7 Ensure all combustibles that can be relocated are moved at least 35 feet in all directions away from the hot work operation.

3.1.8 IF relocation of combustibles is impractical, THEN ensure combustibles are protected by any of the following:

- Welding blanket
- Welding curtain
- Welding pad

**NOTE:** *See Notes 3A and 3B in **Appendix E, Hot Work 35-Foot Rule**, clarifying acceptable location of protected combustibles within the 35-foot radius.*

3.1.9 IF floor and wall openings are present within 35 feet of the work location, THEN ensure the openings are protected as noted in the hot work permit.

3.1.10 IF ducts and conveyor systems that might carry sparks to distant combustibles are present within the work site, THEN protect the ducts and conveyor systems by shielding, shut down, or both.

<i>UPF Hot Work Permit</i>
----------------------------

3.1.11 IF hot work is done near any of the following:

- Walls
- Partitions
- Ceilings
- Roofs of combustible construction

THEN ensure they are protected by any of the following:

- Welding curtain
- Welding blanket
- Welding pad

3.1.12 IF hot work is done on one side of the following AND combustibles are on the other side of the following:

- A wall
- Partition
- Ceiling
- Roof

THEN perform one of the following:

- Ensure precautions have been taken to prevent ignition of combustibles on the other side by relocating the combustibles

OR

- Ensure a Fire Watch is provided on the side opposite from where the work is being performed

3.1.13 Ensure hot work will NOT be attempted on a partition, wall, ceiling, or roof that has a combustible covering or insulation.

3.1.14 Ensure hot work will NOT be attempted on walls or partitions of combustible sandwich-type panel construction.

3.1.15 IF hot work is close enough to cause ignition by conduction while performing hot work on pipes or other metal that is in contact with combustibles, such as, but not limited to the following:

- Combustible walls
- Combustible partitions
- Combustible ceilings
- Combustible roofs

THEN prohibit hot work from being performed.



**UPF Hot Work Permit**

- 3.1.16 Ensure a fully charged and inspected 10-pound (minimum), Class ABC dry chemical or equivalent fire extinguisher is available at the work area.
- 3.1.17 Identify sprinkler heads and smoke detectors in close proximity to the hot work.
- 3.1.18 IF hot work will be performed in an area protected by a sprinkler system when the system is impaired, THEN the requirements of National Fire Protection Association (NFPA) 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, must be met, and ensure approval by the BNI FPE (or designee) is documented on CFN-1139.

**CAUTION**

**Smoke detectors and sprinkler heads can be damaged by contact with residue, heat, fumes, and smoke generated by hot work operations. Heat from the hot work operation may damage the metal alloy fusible link within the sprinkler head and affect its activation.**

Consult the BNI FPE to ensure sprinkler heads and fire detection systems are adequately protected within the hot work area and documented on CFN-1139.

- 3.1.19 Ensure the operator and nearby personnel are suitably protected against dangers such as heat, sparks, and slag. Refer to the Job Hazard Analysis or UPF-CP-205, *Personal Protective Equipment and Safe Work Apparel*, for the appropriate selection to minimize the potential for ignition, burning, trapping hot sparks, and electric shock.

**NOTE:** *Appendix D, Fire Watch Decision Tree, is provided to determine when a Fire Watch is necessary. Appendix E demonstrates the hot work 35-Foot Rule.*

- 3.1.20 Designate a Fire Watch for the hot work operation.

**NOTE:** *In certain situations, additional Fire Watches may be necessary (e.g., line-of-sight or Travel path to perform Fire Watch duties are impeded, hot work performed near open shafts, elevated heights, or where sparks can travel through spaces such as openings).*

IF sparks or slag produced by the hot work operation cannot be directly observed by the initial Fire Watch, THEN ensure an addition Fire Watch is provided.

- 3.1.21 IF hot work will be performed in a Permit-Required Area, THEN ensure the inspection of the work location is documented and approved on CFN-1139.
- IF the permit will extend beyond the issued shift, THEN re-inspect the Permit-Required Area to validate the Hot Work Permit
  - Post the Hot Work Permit at the job location
  - WHEN the Permit-Required Area closes or is no longer valid, THEN turn CFN-1139 in to the UPF Document Management Center (DMC)
- 3.1.22 IF hot work will be performed in a Designated Area, THEN ensure the inspection of the work location is documented and approved on Section 1 of CFN-1137.
- Submit CFN-1137 to the Project Superintendent (or designee) for approval
  - Ensure CFN-1138, *UPF Designated Area for Hot Work Placard*, has been completed

UPF Hot Work Permit
---------------------

- Post CFN-1138 at all access points of a Designated Area
- WHEN the Designated Area closes or is no longer valid, THEN turn CFN-1137 in to the UPF DMC

**BNI Fire Protection Engineer**

- 3.1.23 Indicate and approve modifications to the 35-Foot Rule on CFN-1139.
- 3.1.24 Approve hot work operations performed in an area protected by a sprinkler system when the system is impaired on CFN-1139.
- 3.1.25 Provide direction for adequate protection of sprinkler heads and fire detection systems within the hot work area and document on CFN-1139.

**3.2 Performing Hot Work****Permit Authorizing Individual**

- 3.2.1 Ensure hot work is coordinated so that operations that could potentially expose combustibles to ignition sources is prohibited during hot work operations.
- 3.2.2 IF hot work will be performed in a Designated Area, THEN ensure the area is inspected in accordance with Section 2, "Permit Authorizing Individual Inspection Criteria," of CFN-1137.
- 3.2.3 In a Designated Area, perform final check of the hot work location 30 minutes after the completion of hot work operations to detect and extinguish smoldering fires.
- 3.2.4 In a Permit-Required Area, close CFN-1139 once the hot work operation and Fire Watch responsibilities are complete.

**Hot Work Operator**

- 3.2.5 Ensure the following:
- The requirements of **Steps 3.1.9** and **3.1.10** are met
  - Ventilation is working properly
  - Equipment is in working order

**NOTE:** *The PAI inspects the area at least once per shift while the hot work permit is in effect to ensure the conditions in accordance with the permit are maintained.*

- 3.2.6 IF hot work will be performed in a hot work Permit-Required Area, THEN ensure the area has been inspected by a PAI.
- 3.2.7 IF the PAI approves of the Permissible Area, THEN perform hot work in accordance with the applicable work package.

**NOTE:** *Fire Screens on the inlet to local exhaust may be used if fumes contain sparks.*

UPF Hot Work Permit
---------------------

- 3.2.8 Use exhaust ventilation devices (e.g., moveable ducts/hoods or portable exhaust units) to remove welding fumes or other airborne contaminants arising from hot work operations as near to the source as possible as determined by ES&H.
- 3.2.9 Ensure work is confined to the area or equipment specified.
- 3.2.10 IF conditions covered by a Hot Work Permit change during hot work operations, THEN perform the following:
1. Stop Work
  2. Notify the PAI
  3. IF the conflicting condition cannot be corrected, THEN request the PAI to close the permit and initiate a new Hot Work Permit with additional controls

### Fire Watch

**NOTE:** *Observations continue while hot work is in progress or until the assigned Fire Watch is relieved by another qualified Fire Watch. All Fire Watches assigned to the hot work, including relief Fire Watches, must review and sign CFN-1139.*

- 3.2.11 A single Fire Watch can support multiple co-located hot work operations as long as:
- The hot work activities are within the same permitted location and covered by a single hot work permit
  - The hot work operations can be observed from the same observation position, and must have clear line-of-sight to the operation
  - Clear communication exists between each hot work operation and the Fire Watch
  - The Fire Watch has clear access to the hot work operation to allow for quick response
- 3.2.12 In a Permit-Required Area, observe hot work operations to ensure fire safe conditions, as specified in the Hot Work Permit, are maintained.
- NOTE:** *The duration of the Fire Watch may be extended if the PAI determines the fire hazards warrant the extension.*
- 3.2.13 Remain in the area for at least 30 minutes after the completion of hot work operations to detect and extinguish smoldering fires.
- 3.2.14 Close CFN-1139 once the hot work operation and Fire Watch responsibilities are complete.

## 4.0 RECORDS

Records generated by this Document shall be maintained in accordance with Y15-95-800, *UPF Document Management*.

The following records generated are:

<i>UPF Hot Work Permit</i>
----------------------------

Record or Form Number	Record Title	System/Location	Document Type
CFN-1137	<i>UPF Designated Area Tracking and Inspection Log</i>	InfoWorks	DAIR
CFN-1139	<i>UPF Hot Work Permit</i>	InfoWorks	HWP

## 5.0 REFERENCES

### 5.1 Source References

29 CFR 1926, *Safety and Health Regulations for Construction*  
 American National Standards Institute (ANSI)/ASC Z49.1 94, *Safety in Welding, Cutting, and Allied Processes*  
 PL-CM-801768-A001, *Construction Management Plan and Execution Strategy*  
 PL-SH-801768-A007, *Bechtel National, Inc. Uranium Processing Facility Environmental, Safety and Health Plan*  
 UPF-CP-211, *Fire Prevention and Protection*  
 Y17-95-64-800, *UPF Construction/Startup Work Control Program*

### 5.2 Interfacing References

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*  
 NFPA 51B, *Fire Prevention During Welding, Cutting, and Other Hot Work*  
 UPF-CP-205, *Personal Protective Equipment and Safe Work Apparel*  
 UPF-CP-227, *UPF Safety Watches*  
 Y15-95-800, *UPF Document Management*  
 Y17-95-64-823, *UPF Field Level Hazard Assessment/Job Hazard Analysis Program (FLHA/JHA) Process*

### 5.3 Forms

CFN-1137, *UPF Designated Area Tracking and Inspection Log*  
 CFN-1138, *UPF Designated Area for Hot Work Placard*  
 CFN-1139, *UPF Hot Work Permit*

## 6.0 SUPPLEMENTAL INFORMATION

Appendix A, *Acronyms and Definitions*  
 Appendix B, *Equipment/Materials within a Permissible Area*  
 Appendix C, *Hot Work Permit Decision Tree*  
 Appendix D, *Fire Watch Decision Tree*

*UPF Hot Work Permit*

Appendix E, *Hot Work 35-Foot Rule*

Appendix F, *Approved Powder Actuated Fastener Tools*

## APPENDIX A Acronyms and Definitions

(Page 1 of 2)

### Acronyms

<b>BNI</b>	Bechtel National, Inc.
<b>DMC</b>	Document Management Center
<b>ES&amp;H</b>	Environmental, Safety, and Health
<b>FPE</b>	Fire Protection Engineer
<b>MIG</b>	Metal Inert Gas
<b>NFPA</b>	National Fire Protection Association
<b>PAI</b>	Permit Authorizing Individual
<b>UPF</b>	Uranium Processing Facility

### Definitions

<b>35-Foot Rule</b>	The initial radius length extending out and encircling the hot work on a horizontal and vertical plane for 35 feet or less to noncombustible material (e.g., concrete wall or floor) and can be modified (i.e., distance extended or reduced) by the PAI based upon hot work operations and/or site conditions.
<b>Combustible Liquids</b>	Liquids having a flashpoint at or above 100°F.
<b>Combustible Material</b>	A material that, in the form in which it is used and under the conditions anticipated, has the characteristic to ignite and burn.
<b>Contractor Authority Having Jurisdiction (AHJ)</b>	An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.
<b>Designated Area</b>	A specific location designed and approved for hot work operations that is maintained fire-safe, such as a maintenance shop or a detached outside location, that is of noncombustible or fire-resistive construction, essentially free of combustible and flammable contents, and suitably segregated from adjacent areas (NFPA 51B, <i>Standard for Fire Prevention During Welding, Cutting, and Other Hot Work</i> ).
<b>Fire Watch</b>	A designated individual trained in specific Fire Watch duties and dedicated to both worker safety and property loss prevention for a specified duration. Performs Fire Watch duties when assigned exclusively; no other duties shall interfere.
<b>Flammable Gas</b>	A material that is a gas at 68°F (20°C) or less at 14.7 pounds per square inch atmosphere (psia) of pressure which: <ul style="list-style-type: none"> <li>• Is ignitable at 14.7 psia when in a mixture of 13 percent or less by volume with air; or</li> <li>• Has a flammable range at 14.7 psia with air of at least 12 percent, regardless of the lower limit. The limits specified shall be determined at 14.7 psi of pressure and a temperature of 68°F in accordance with ASTM E 681</li> </ul>

## APPENDIX A Acronyms and Definitions

(Page 2 of 2)

<b>Flammable Liquids</b>	Liquids having a flashpoint below 100°F.
<b>Hot Work</b>	Work involving burning, welding, grinding, or a similar operation that is capable of initiating fires or explosions.
<b>Hot Work Area</b>	Encompasses the area defined by the 35-Foot Rule or modified by the PAI.
<b>Hot Work Permit</b>	A permit issued by the PAI to authorize work involving burning, welding, or a similar operation capable of initiating fires or explosions in a non-designated area, which is based on implementing preventative actions and precautions.
<b>Permissible Area</b>	A Designated Area or Permit-Required Area as defined by this Procedure.
<b>Permit Authorizing Individual (PAI)</b>	The individual designated by management to authorize Hot Work Permits.
<b>Permit-Required Area</b>	Any location other than a designated area that is approved for hot work and is made fire-safe by removing or protecting combustibles from ignition sources.
<b>Welding Blanket</b>	A heat-resistant fabric listed, approved, and designed to be placed in the vicinity of a hot work operation; intended for use in horizontal applications with light to moderate exposures such as that resulting from chipping, grinding, heat treating, sand blasting, and light horizontal welding; designed to protect machinery and prevent ignition of combustibles such as wood that are located adjacent to the underside of the blanket.
<b>Welding Curtain</b>	A heat-resistant fabric listed, approved, and designed to be placed in the vicinity of a hot work operation, intended for use in vertical applications with light to moderate exposures such as that resulting from chipping, grinding, heat treating, sand blasting, and light horizontal welding; designed to prevent sparks from escaping an area.
<b>Welding Pads</b>	A heat-resistant fabric listed, approved, and designed to be placed directly under a hot work operation such as welding or cutting, intended for use in horizontal applications with severe exposures such as that resulting from molten substances or heavy horizontal welding; designed to prevent the ignition of combustibles that are located adjacent to the underside of the pad.

## **APPENDIX B**

### **Equipment/Materials within a Permissible Area**

The list below is an example of items and is not all-inclusive. Each area is required to be evaluated by a PAI using their best judgment on a case-by-case basis.

The following is a partial list of example items that would be allowed within a Permissible Area and still be considered essentially free of combustibles:


- Gas lines for hot work equipment
- Air hoses for hot work equipment
- Electric cords/cables for hot work equipment
- Non-combustible walls (concrete, gypsum wallboard on metal studs, steel partitions to segregate a welding area) without openings or cracks in the construction for at least a height of five feet above the hot work surface
- Non-combustible floor (concrete, earth, steel) without openings or cracks to floor/area below, as applicable
- Heavy timber (greater than a typical 4 inches x 4 inches) necessary to support material
- Tools (e.g., wire brush, soap stone, MIG pliers, screw drivers, chipping hammer, torpedo level) necessary to perform hot work
- Bollards/candlestick stands/cones, barricade tape/chain/rope, and signage/tags necessary to support hot work
- Fire-resistive lumber

The following list is to provide guidance of combustibles that are prohibited when uncovered or less than 35 feet from hot work within a Permissible Area:

- Cardboard
- Paper and binders
- Shrink-wrap or wind screening material that is not clearly marked or labeled as meeting the listing or approval for hot work operations; contact the BNI FPE or ES&H with questions
- Fire-resistant/fire-retardant plastic sheeting
- Combustible/flammable liquids and compressed gases
- Wooden materials not treated with fire retardants
- Plastic products (e.g., trash cans, five-gallon buckets)




### APPENDIX C Hot Work Permit Decision Tree

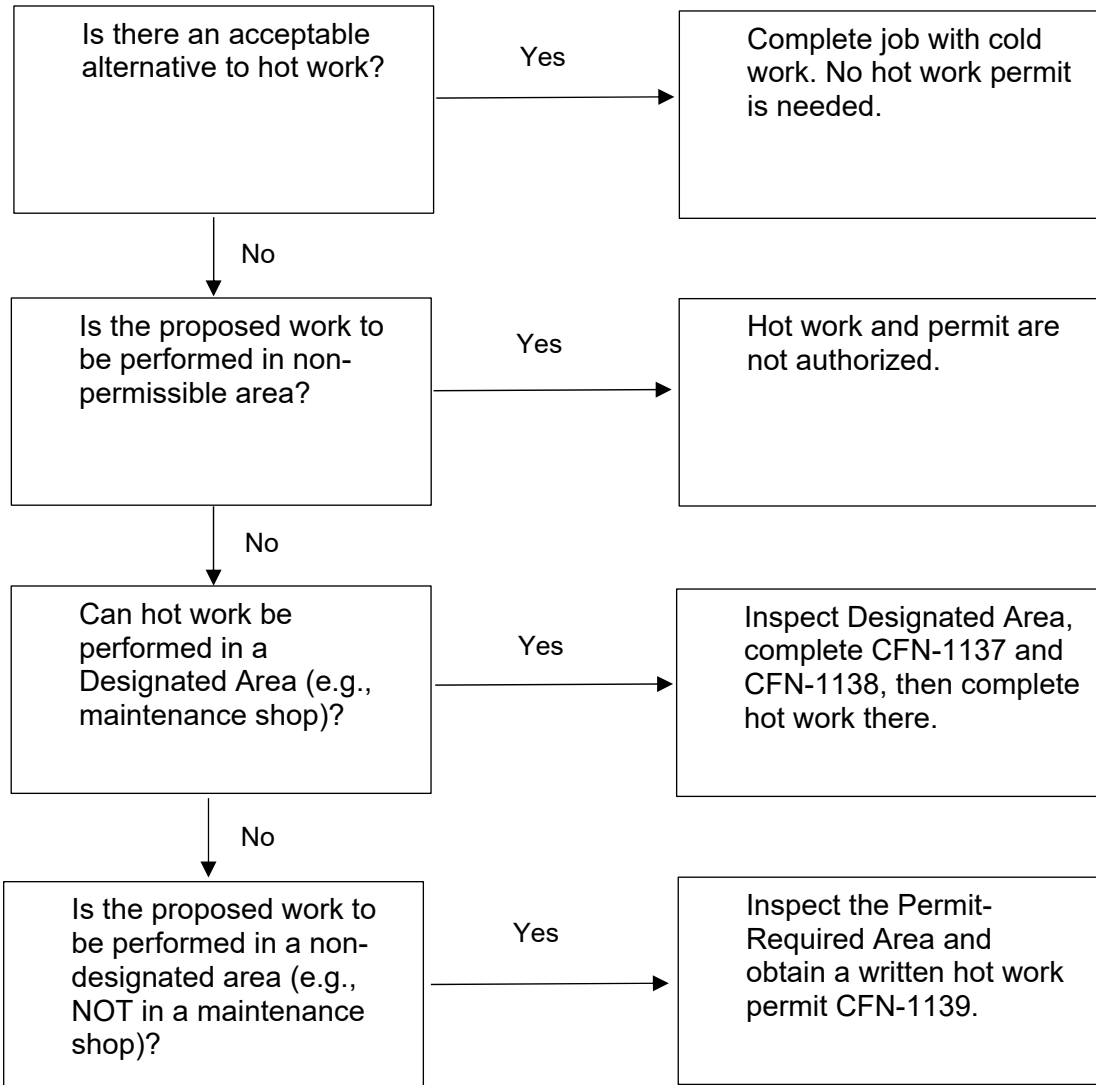


**Figure C-1. Hot Work Permit Decision Tree**

## APPENDIX D Fire Watch Decision Tree

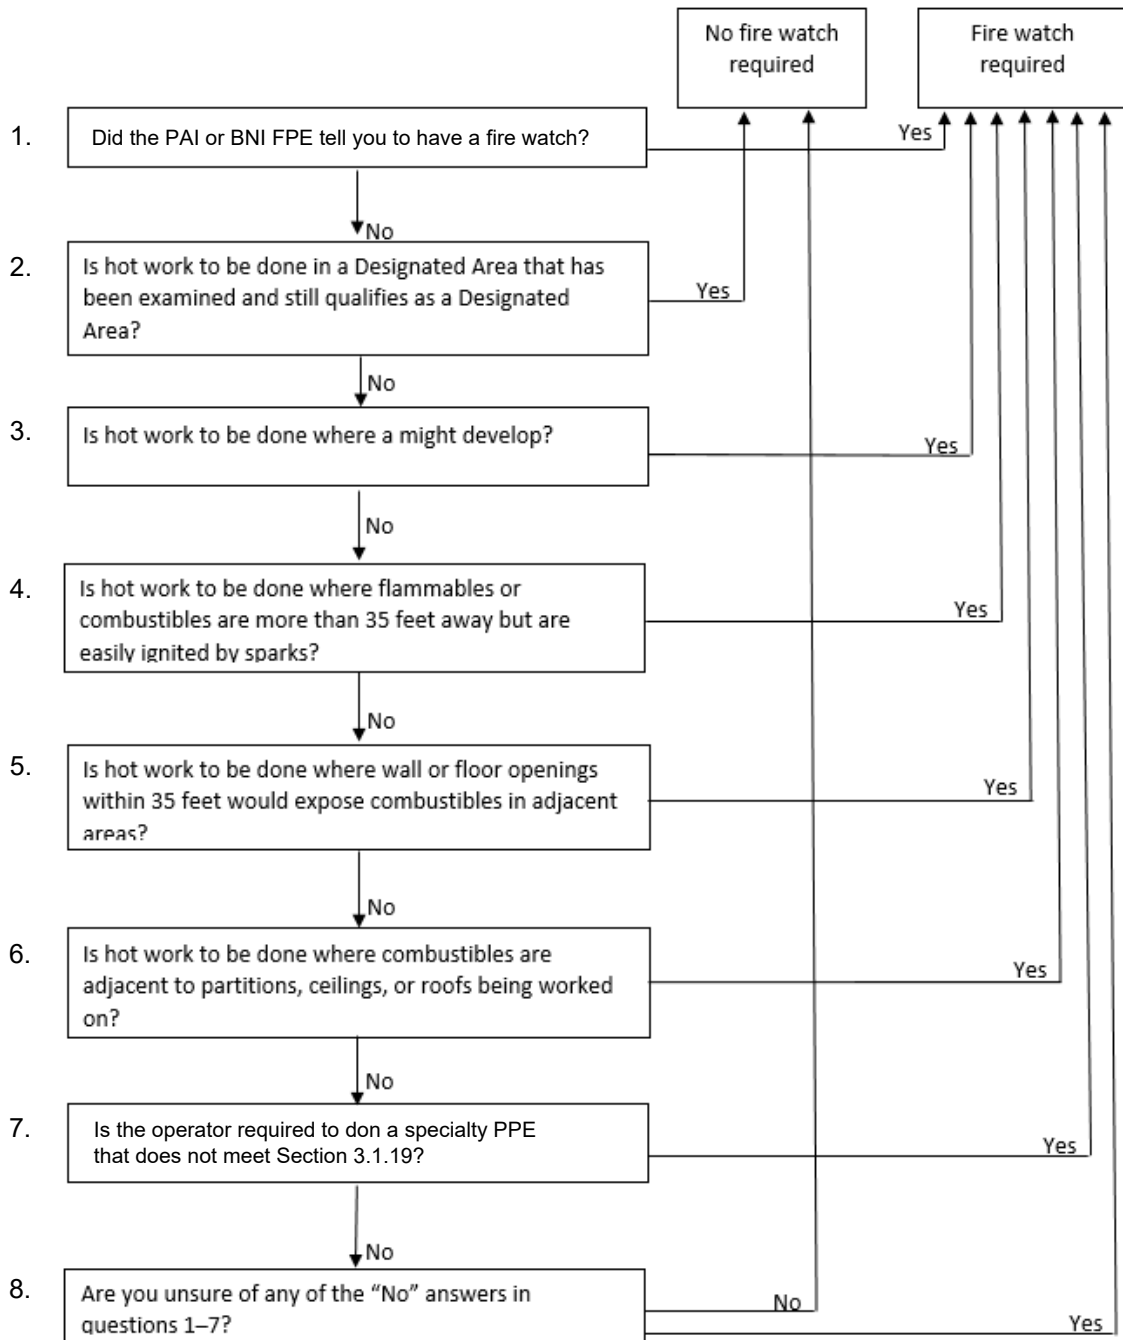


**Figure D-1. Fire Watch Decision Tree Diagram**

## APPENDIX E Hot Work 35-Foot Rule

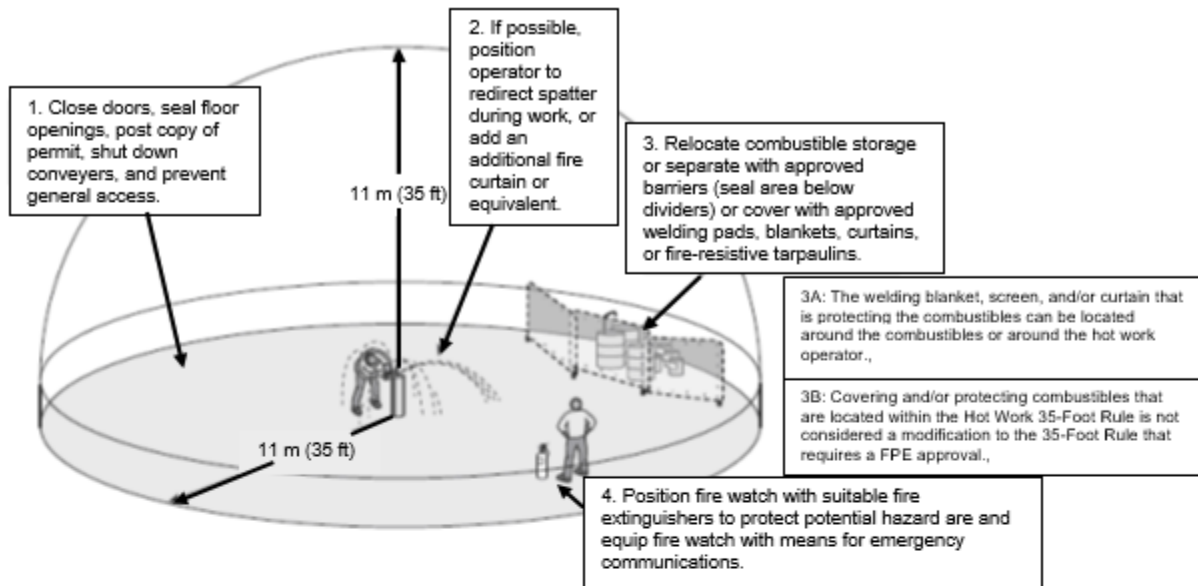

### 35 Foot Rule Illustrated

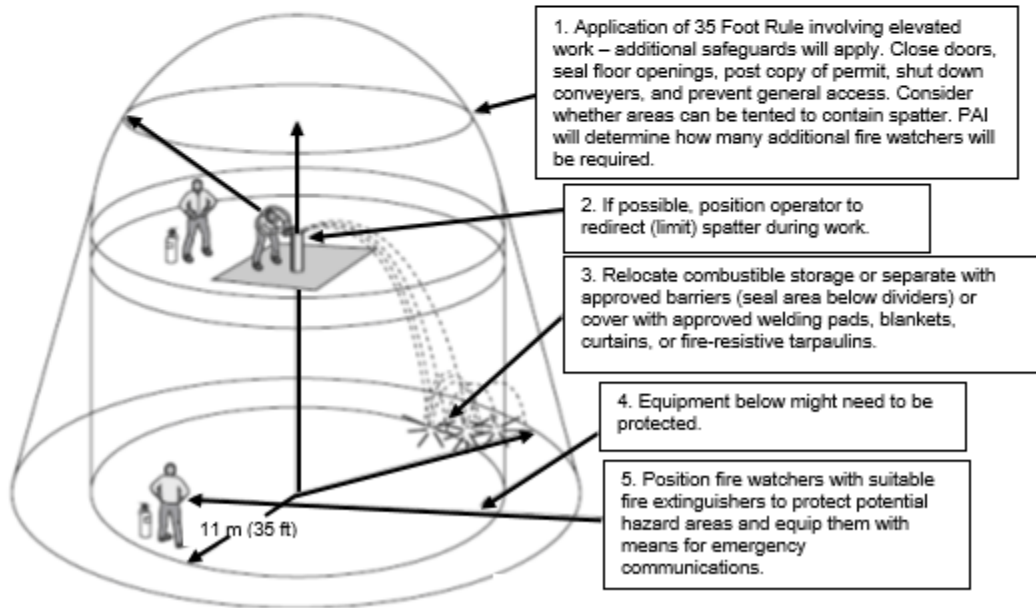

### Example of Where Multiple Fire Watches Are Needed

Figure E-1. Hot Work 35-Foot-Rule Diagram

## **APPENDIX F**

### **Approved Powder Actuated Fastener Tools**

The following powder actuated fastener tools have been evaluated and determined not to require a Hot Work Permit.

- Hilti Model DX2
- Hilti Model DX 5
- Hilti Model DX 9-ENP
- Hilti Model DX76-MX

### **DISCLAIMER**

This work of authorship and those incorporated herein were prepared by Consolidated Nuclear Security, LLC (CNS) as accounts of work sponsored by an agency of the United States Government under Contract DE-NA-0001942. Neither the United States Government nor any agency thereof, nor CNS, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility to any non-governmental recipient hereof for the accuracy, completeness, use made, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency or contractor thereof, or by CNS. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency or contractor (other than the authors) thereof.

### **COPYRIGHT NOTICE**

This document has been authored by Consolidated Nuclear Security, LLC, under Contract DE-NA-0001942 with the U.S. Department of Energy/National Nuclear Security Administration, or a subcontractor thereof. The United States Government retains and the publisher, by accepting the document for publication, acknowledges that the United States Government retains a nonexclusive, paid-up, irrevocable, world-wide license to publish or reproduce the published form of this document, prepare derivative works, distribute copies to the public, and perform publicly and display publicly, or allow others to do so, for United States Government purposes.